

Pipeline Systems Operation Map 2018

Date: 6/19/2018

Customer(s): DONALD PARKER


District: TWIN PLATTE NRD

Field Office: Ogallala S.C.

Agency: USDA-NRCS

Assisted By: TIM GRIFFIN

All Shut Off Valves
must remain closed during normal
operation or pipeline failure may occur.

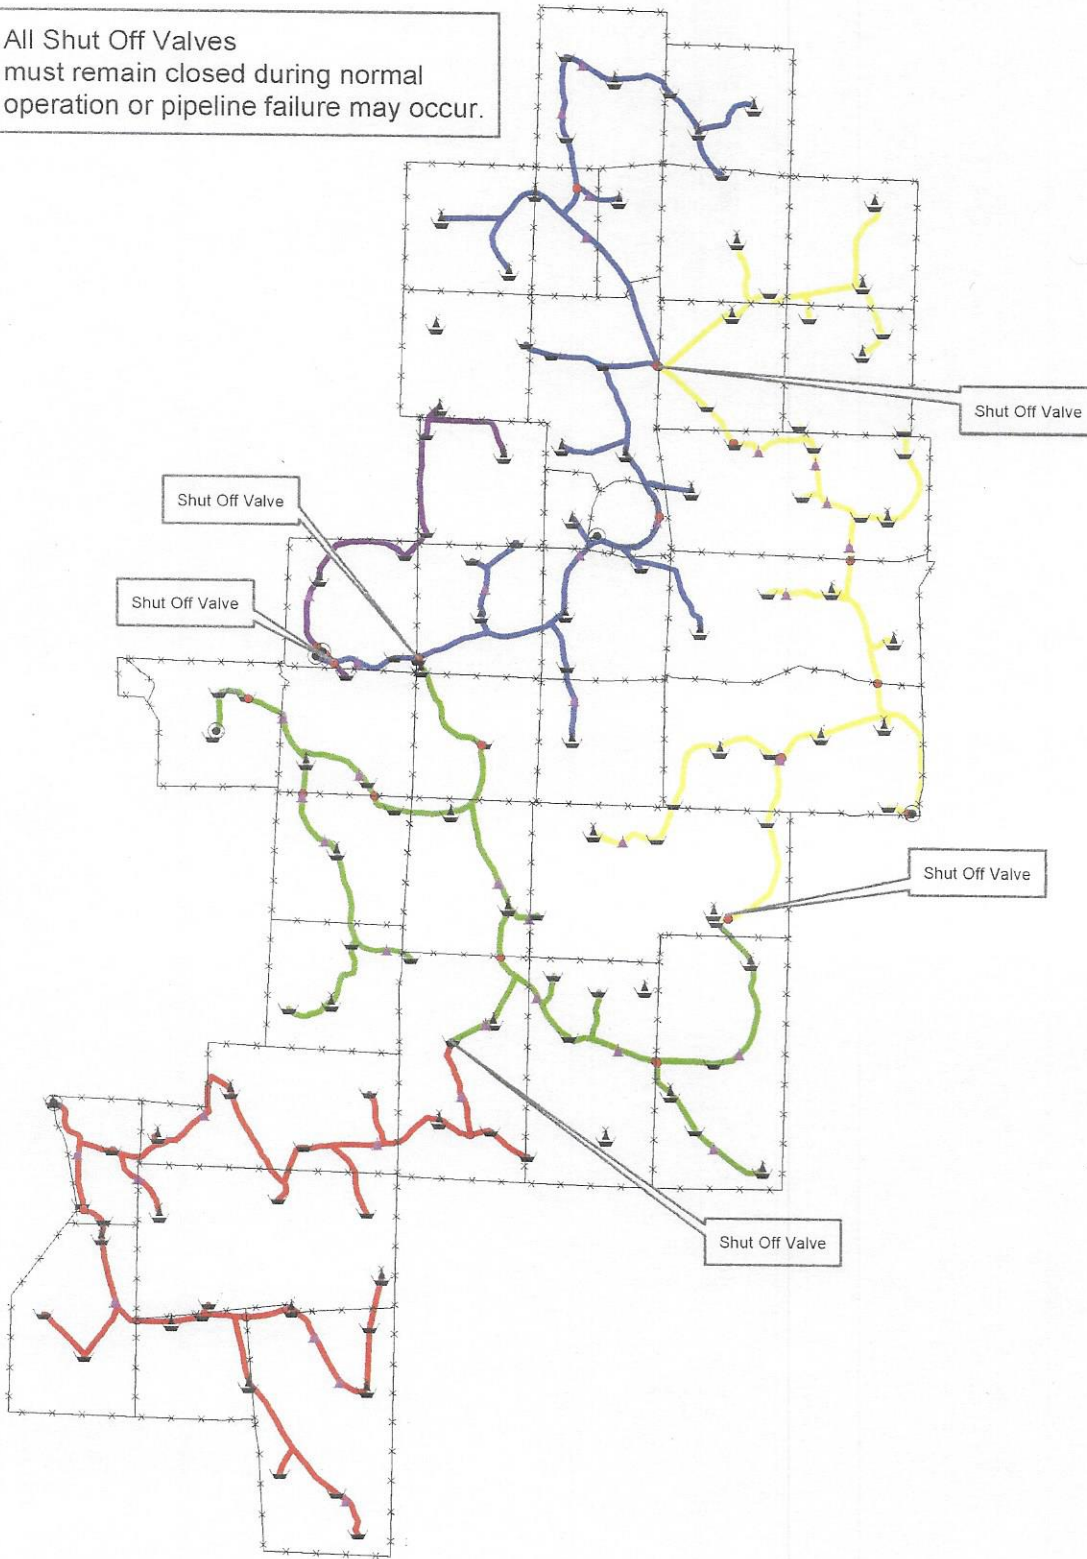

Legend

—x—x— proposed fence 2018

—x—x— Existing fence

Existing water pts LABEL

▽ Tank

▲ Windmill

▲ AVR

● valves

⊙ Sub. Well 6

⊙ Sub. Well 1

⊙ Sub. Well 2

⊙ Sub. Well 3

⊙ Sub. Well 4

⊙ Sub. Well 5

Existing pipeline SYSTEM

— East

— Middle

— North

— South

— West